building science.com
© 2000 Building Science Press All rights of reproduction in any form reserved.

Systems Engineering Approach to Development of Advanced Residential Buildings

Research Report – 0010

8-November-2000
Kohta Ueno

Abstract:

This is a report describing the test methodology and results for experiments run on two test houses at the Bonita Springs development in Fort Myers, FL. The goal was to determine the effect of attic ventilation in a hot-humid climate; previous work had shown that little to no benefit is derived from ventilation in terms of energy use, and that it is detrimental for moisture control. Two houses with identical orientations and plans were compared; one was ventilated at the typical 1:300 ratio, and the other had sealed vents. This work was conducted in order to move houses in hot-humid climates forward in technology in their building envelope and HVAC systems.

BUILDING AMERICA

SYSTEMS ENGINEERING APPROACH TO DEVELOPMENT OF ADVANCED RESIDENTIAL BUILDINGS

8.A.04B FINAL REPORT: PULTE FORT MYERS

RE: TASK ORDER NO. KAR-8-18412-05

UNDER
TASK ORDERING AGREEMENT NO. KAR-8-18412-00

MIDWEST RESEARCH INSTITUTE,
NATIONAL RENEWABLE ENERGY LABORATORY DIVISION,
1617 COLE BOULEVARD,
GOLDEN, CO
80401-3393

BUILDING SCIENCE CONSORTIUM
CONSORTIUM LEADER:

BUILDING SCIENCE CORPORATION
70 MAIN STREET, WESTFORD, MA
(978) 589-5100
CONTACT: BETSY PETTIT, AIA

CONSORTIUM MEMBERS:

PULTE HOME CORPORATION
IDEAL HOMES
CENTEX HOMES
Del Webb
TOWN AND COUNTRY HOMES
STURBRIDGE CONSTRUCTION
DEC INTERNATIONAL, INC.
ENERGY EFFICIENT BUILDING ASSOCIATION, INC.
THE DOW CHEMICAL COMPANY
US GREENFIBER A LOUISIANA-PACIFIC COMPANY

NOVEMBER 8, 2000

Table of Contents

Executive Summary 3
Background 4
Test Methodology 5
Photos of Test Houses 6
Photos of Ventilation Closure (Unvented House) 7
Results: Building Assembly Temperatures 8
Results: Attic Air Temperatures 12
Results: Attic Moisture Behavior 13
Energy Impacts of Roof Ventilation 16
Conclusions 17
Datalogging Equipment Summary 18
References 19

EXECUTIVE SUMMARY

This is a report describing the test methodology and results for experiments run on two test houses at the Bonita Springs development in Fort Myers, FL. The goal was to determine the effect of attic ventilation in a hot-humid climate; previous work had shown that little to no benefit is derived from ventilation in terms of energy use, and that it is detrimental for moisture control. Two houses with identical orientations and plans were compared; one was ventilated at the typical 1:300 ratio, and the other had sealed vents. This work was conducted in order to move houses in hot-humid climates forward in technology in their building envelope and HVAC systems.

Temperatures and relative humidities of attic and house air, and temperatures of roof tile, roof sheathing, and insulation top were measured for a two-month period (September through October). Outdoor conditions were also recorded; power consumption was not directly monitored.

After this monitoring period, several conclusions could be drawn in regards to the effect of venting on thermal and moisture performance. The temperatures of roof components (tile, sheathing, and insulation) were slightly elevated in the unvented house, but the effect on building durability appears to be minimal.

Attic air temperature was increased (maximum peak difference of 10° F) in the unvented house; however, the overall energy effect of this change is minimal. The elimination of attic venting reduces latent load, as well as infiltration and exfiltration due to wind pressures acting on the leaky ceiling plane. Therefore, overall energy performance may be improved by eliminating attic ventilation. The unvented roof showed superior moisture performance, as humid outdoor air was no longer being introduced through vents.

Overall, more study is recommended. Data will be collected again at the end of the winter, and at the end of the following summer.

BACKGROUND

The effect of attic ventilation on cooling performance and moisture levels has been a matter of particular study for the past two decades. Burch and Treado (1979) found that attic ventilation is not an effective energy conservation procedure for houses with insulation thicknesses of 4 in and 6.5 in; this even proved true with the air conditioning supply ductwork in the attic.
The typical code 1:300 ventilation ratio is geared towards prevention of moisture condensation buildup in cold climates during the heating season. In hot-humid climates, attic ventilation is detrimental to moisture-related performance, and energy benefits from ventilation are questionable.

Work by Rudd and Lstiburek (1997) used a finite element computer model to predict energy use, roof temperatures, and moisture behavior in Orlando, FL (hot-humid) and Las Vegas, NV (hot-dry) climates. Results showed that a "cathedralized" attic, which places both the air barrier and thermal barrier at the roof deck (resulting in a 'conditioned attic'), served to minimize or eliminate moisture accumulation potential in hot-humid climates without an energy penalty. The impact of an unvented unconditioned attic (an attic where insulation is located at the ceiling plane; i.e., a 'typical' attic but without ventilation) on energy usage was examined; it showed some increase in peak ceiling heat flux. However, moisture performance of this system was not investigated.

This work compares an unvented unconditioned attic with a standard construction vented attic in a hot humid climate (Fort Myers, FL). Temperatures and relative humidities of attic and house air, and temperatures of roof tile, roof sheathing, and insulation top were measured for a two-month period at the end of summer. Outdoor conditions were also recorded; power consumption was not directly monitored.

TEST METHODOLOGY

Two houses with the same orientation and floor plan were selected in a new construction subdivision in Fort Myers, FL (see Photos of Test Houses).

In one house (Lot 12; Unvented house; 9164 Spring Run Boulevard), attic ventilation was closed. The openings for the upper tile vents were covered with rigid insulation board and airsealed; the perforated aluminum soffit vent was sealed with a heavy elastomeric paint (see Photos Of Ventilation Closure, Unvented House). Although this sealed the perforations, some openings remained (for instance, at the J-channel intersection). In the other house, (Lot 8; Vented house; 9148 Spring Run Boulevard) the ventilation was retained, at the 1:300 ratio, as per SBCCI requirements.

Monitoring equipment was installed at both houses; measurements included:

- **Attic air temperature (3 measurements)**
- **Attic air relative humidity (2 measurements)**

- **Return air temperature (2 measurements)**
- **Return air relative humidity (2 measurements)**

- **Tile top temperature**
- **Plywood roof sheathing temperature (underside)**
- **Insulation top temperature**

Data was recorded as hourly averages; hourly standard deviations were also recorded. All building assembly temperatures were recorded on the worst-case (west-facing) side. In addition, outdoor temperature and relative humidity were recorded. Data was recorded from late August 2000 through late October 2000; equipment was left in place to record winter results.

PHOTOS OF TEST HOUSES

Lot 8; Vented house (9148 Spring Run Boulevard)

Lot 12; Unvented house (9164 Spring Run Boulevard)

PHOTOS OF VENTILATION CLOSURE (UNVENTED HOUSE)

Center-front corner

Right-hand side (towards rear)

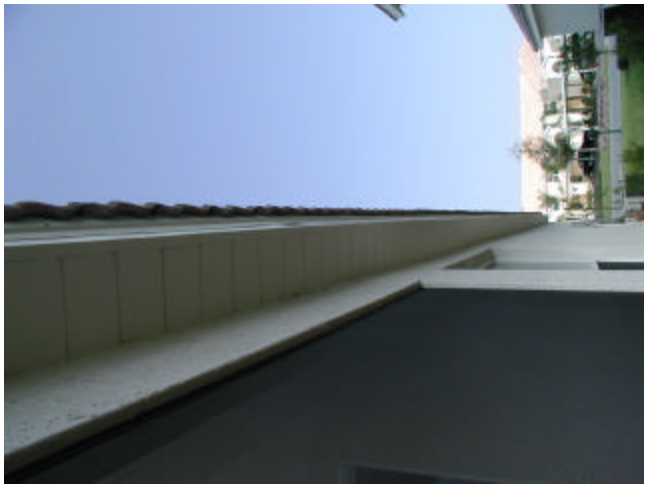

Left-hand side (towards front)

RESULTS: BUILDING ASSEMBLY TEMPERATURES

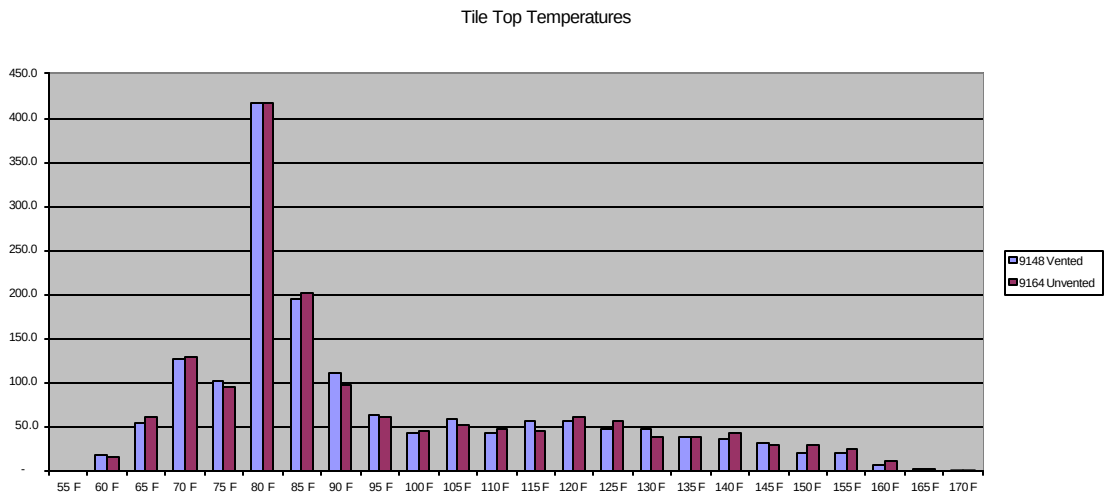

Tile Temperatures	Vented	Unvented	Difference
Mean	91.8	92.3	(0.5)
Maximum	166.0	165.9	0.1
Minimum	56.7	56.5	0.3
Standard Deviation	23.4	24.2	(0.8)

The tile top temperatures were very similar. This response is consistent with the fact that tiles are "self-venting" with the air space formed underneath them in a typical installation. Furthermore, this space 'uncouples' the roof tiles from the rest of the roof system.

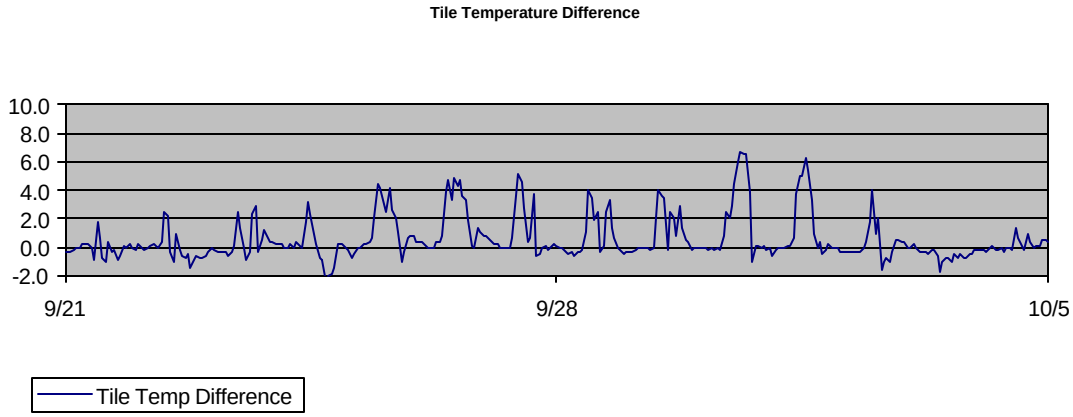

The graph above shows the difference in temperature between the roof tiles in the two houses. It is near zero at night, and has daily peaks from noon to early evening (6 PM); peak temperature differences were approximately 5-7° F. As seen in the graph, the tile temperature in the unvented house is occasionally lower than the vented house (below zero).

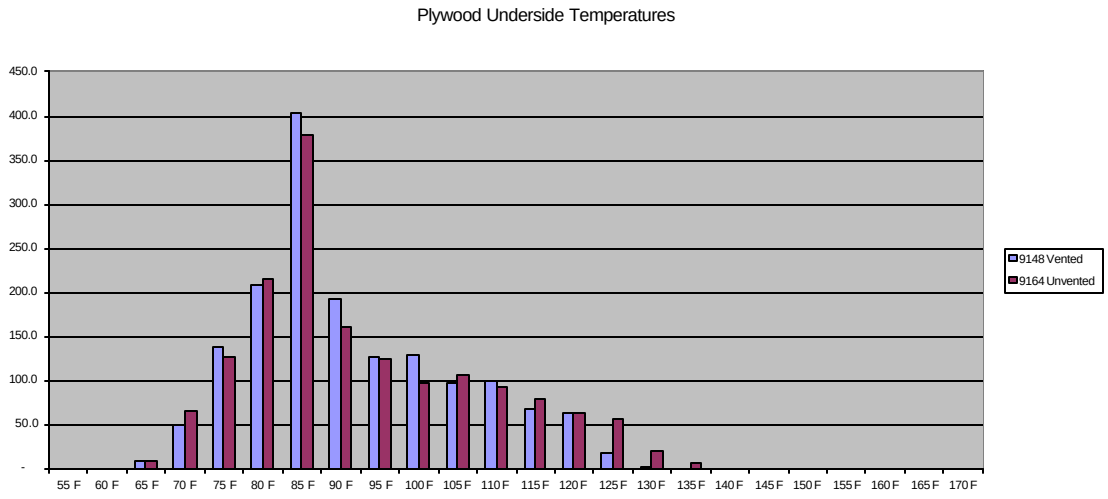

Plywood Temperatures	Vented	Unvented	Difference
Mean	89.0	90.5	(1.5)
Maximum	128.6	135.0	(6.4)
Minimum	61.2	61.2	(0.0)
Standard Deviation	13.4	15.3	(1.8)

Plywood roof sheathing temperatures showed a slightly greater difference average temperature of 1.5° F. Difference in maximum temperatures was 6.4° F.

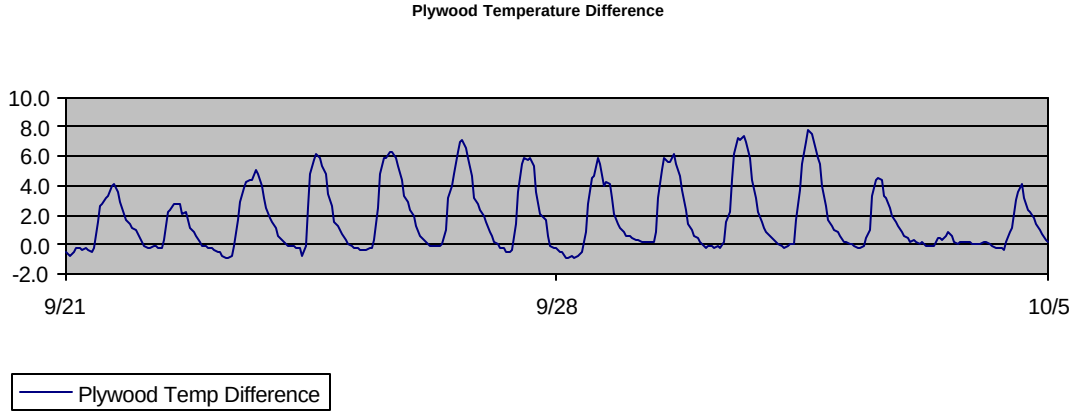

The instantaneous temperature differences between the two houses were computed over the test period. The average of the differences was 1.5° F; the maximum was 7.8° F. The graph above shows the temperature difference; peaks typically occurred in the late afternoon (4 to 6 PM).

Rate of aging and lifespan of building components are related to absolute temperature (TenWolde and Rose, 1999). The 7.8° F peak difference translates to less than a 2% difference in absolute temperature; over the life cycle of the building envelope, this appears to be a minimal effect.

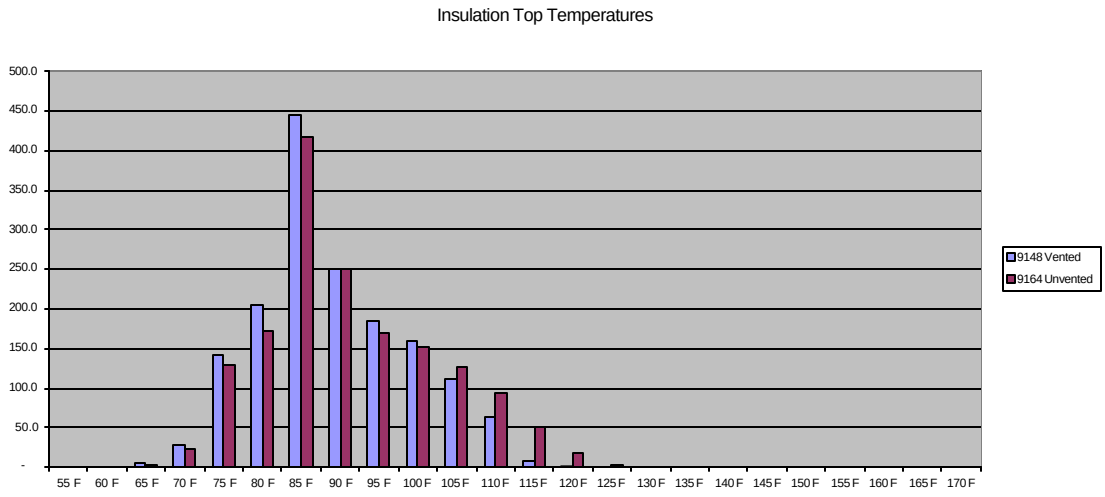

Insulation Top Temperatures	Vented	Unvented	Difference
Mean	86.6	88.7	(2.0)
Maximum	115.5	121.2	(5.7)
Minimum	62.8	64.0	(1.2)
Standard Deviation	9.7	11.2	(1.5)

Temperature was measured at the top of the insulation (just under the surface); as in the previous measurements there was some difference (~2° F average) between the two houses. The difference of maximums was 5.7° F.

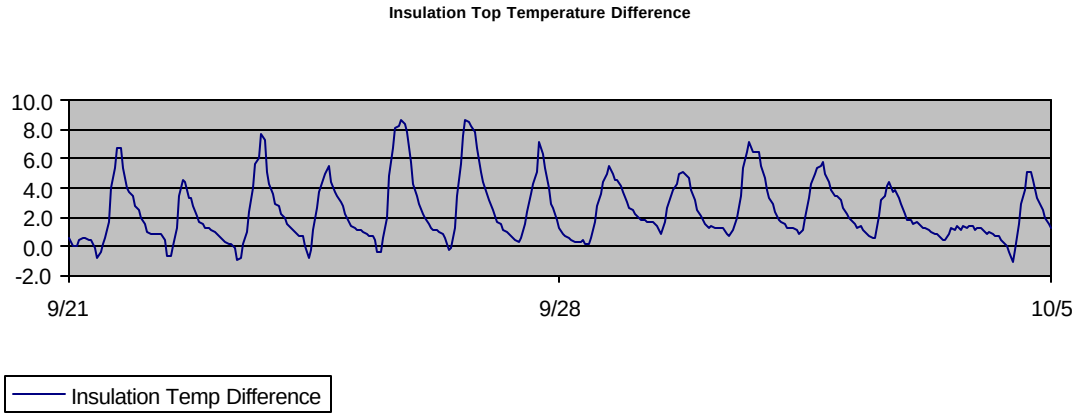

In the instantaneous differences, the average was 2° F, and the maximum instantaneous difference was 10.7° F. In the graph of temperature differences, peaks were mostly in the range of 6-10° F; they occurred in the early evening (6-7 PM).

Slight differences in cardinal orientation, shading, and sensor placement between the two houses could have an effect on some of the temperature measurements. More measurements in more locations would provide more detailed information, however, we would not expect a change in the trends presented here.

RESULTS: ATTIC AIR TEMPERATURES

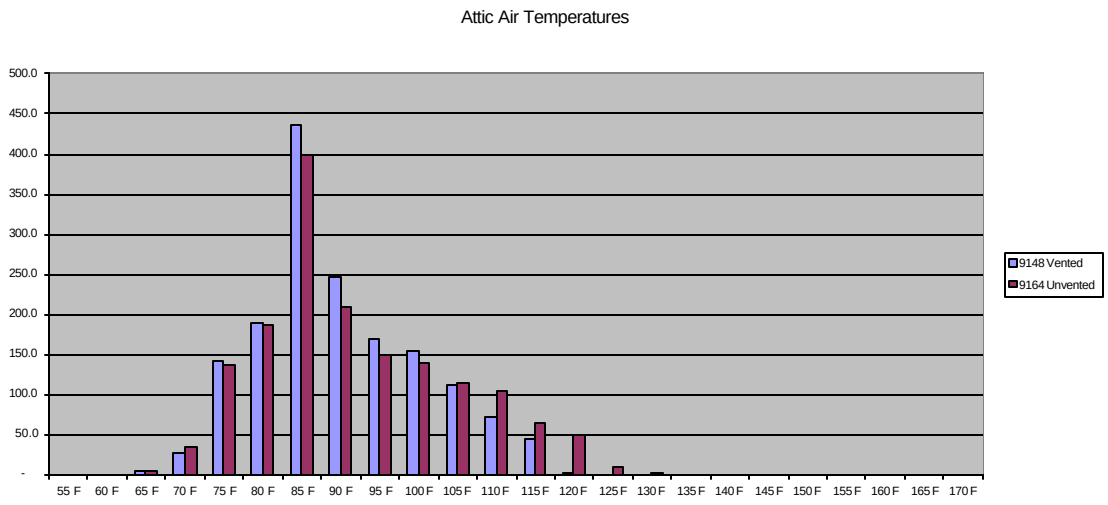

Attic Air Temperatures	Vented	Unvented	Difference
Mean	87.5	89.3	(1.8)
Maximum	117.8	126.3	(8.5)
Minimum	62.3	62.8	(0.5)
Standard Deviation	10.7	12.7	(2.0)

As with the roof assembly materials, there was a temperature difference; the difference in averages was 1.8° F; difference of maximums was 8.5° F. In computing the instantaneous differences, average difference was 1.8° F; maximum instantaneous difference was 10.1° F.

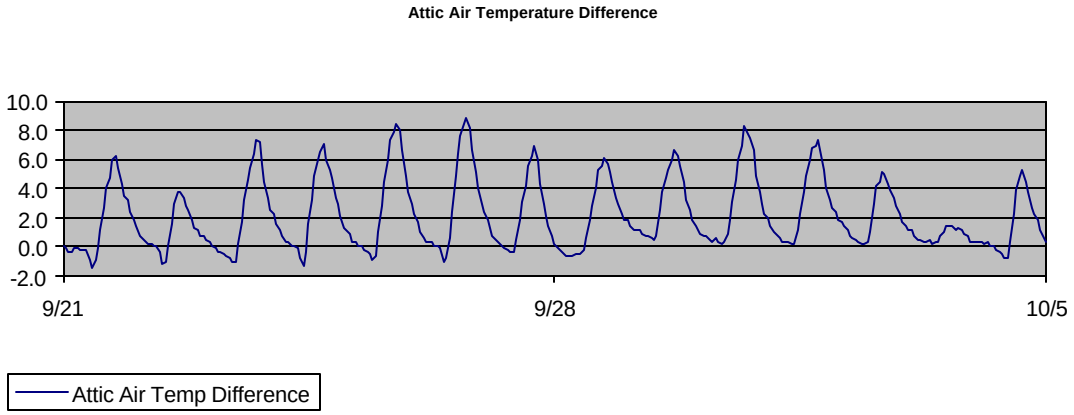

Attic air temperature differences also followed a daily sinusoidal pattern; peaks occurred around 6-7 PM, mostly in the range of 6-8° F. Note the "phase-shifting" effect, as compared with tile and plywood temperature differences. The attic air and insulation typically experience the peak difference an hour or two after the plywood.

RESULTS: ATTIC MOISTURE BEHAVIOR

A basic presentation of the results is graphs of attic air relative humidity and temperature, as shown below.

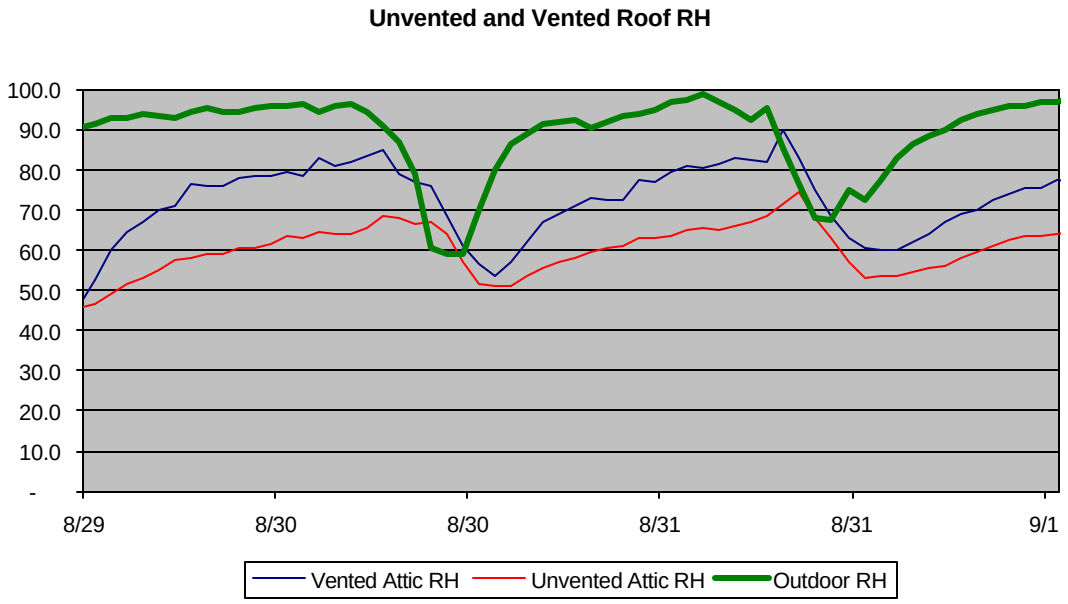

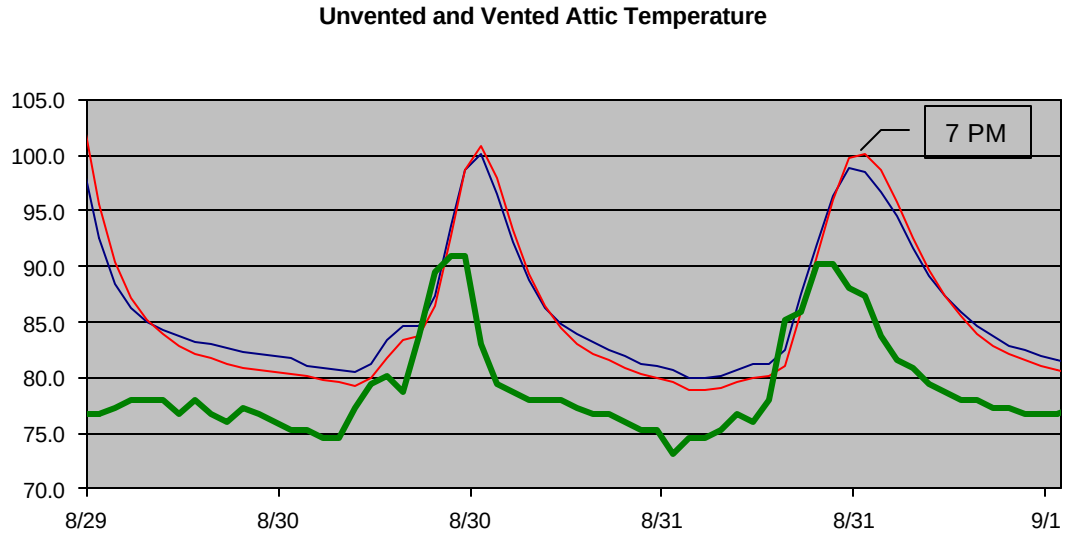

The unvented attic relative humidity was consistently lower than the vented attic. Peaks in temperature were in early evening (5-7 PM) and peaks in humidity were coincident with lowest temperatures. Some of the difference in relative humidity is attributable to the difference in temperature (i.e., higher temperatures result in lower relative humidity), however, an 80 to 78° F temperature drop is only equivalent to ~5% or less RH change. Therefore, there is a difference in absolute moisture content, as shown by measurement of the attic air dew point.

Rudd and Lstiburek (1997) noted that the attic dewpoint can rise above the outdoor dewpoint during the day (thus raising the likelihood of condensation) due to sorption and desorption of moisture from the wood framing members in day-night cycles. The process was described as follows:

Nighttime

- high attic air relative humidity due to air exchange with outdoors
- lower surface relative humidity of wood framing materials
- resulting in moisture being adsorbed by wood framing materials
- attic air dewpoint similar to outdoors

Daytime

- lower attic air relative humidity due to sensible solar heat gain
- higher surface relative humidity of wood framing materials
- resulting in moisture being desorbed by wood framing materials
- attic air dewpoint elevated above outdoors

This behavior is seen in the vented roof in the graph below; attic dewpoint (blue) is greater than outdoors (green), peaking at early evening (~6 PM). During the late evening and morning, attic dewpoint is similar to outdoor dewpoint.

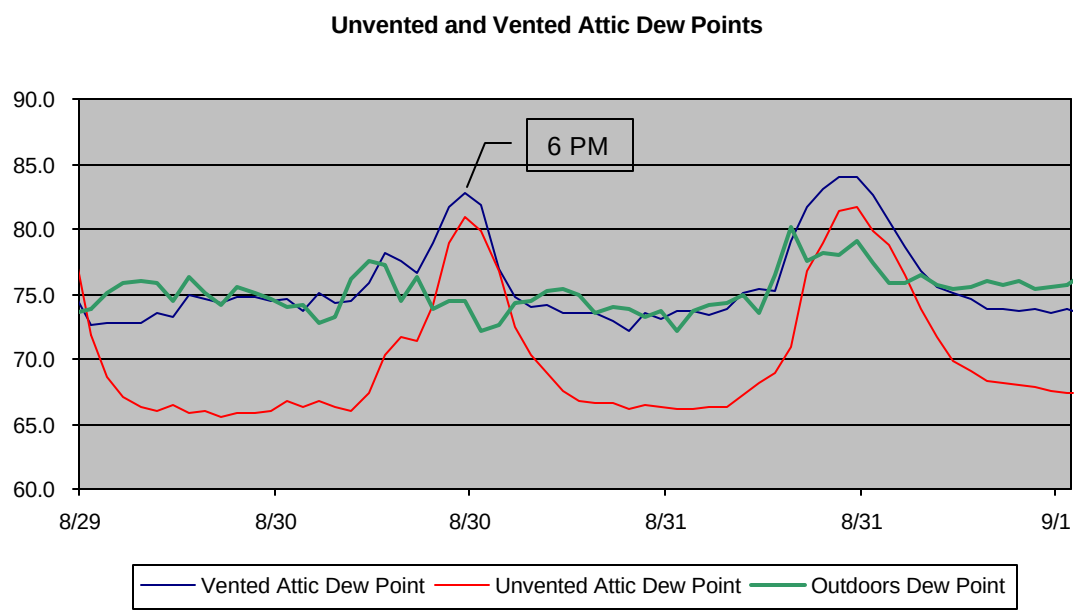

In the unvented attic, however, the attic dewpoint drops below the outdoor dewpoint significantly; this is most pronounced from the evening through late morning. Furthermore, the peak dewpoint measurements are lower than that of the vented attic (although they are greater than outdoor dewpoint measurements).

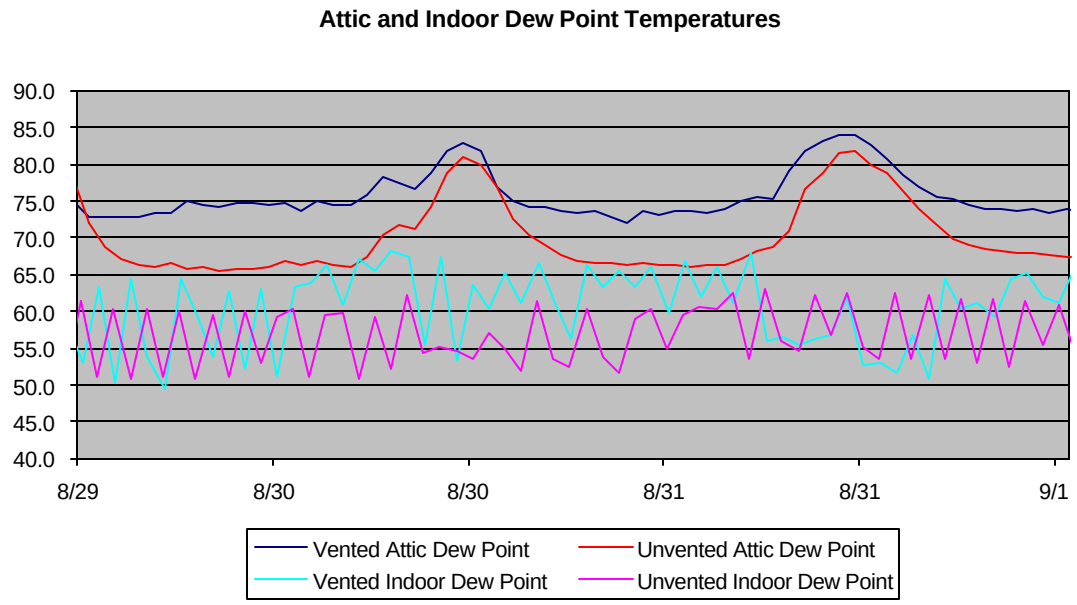

This graph repeats the vented and unvented data, with the indoor dewpoint data shown in comparison. The indoor dewpoint is lower and more stable.

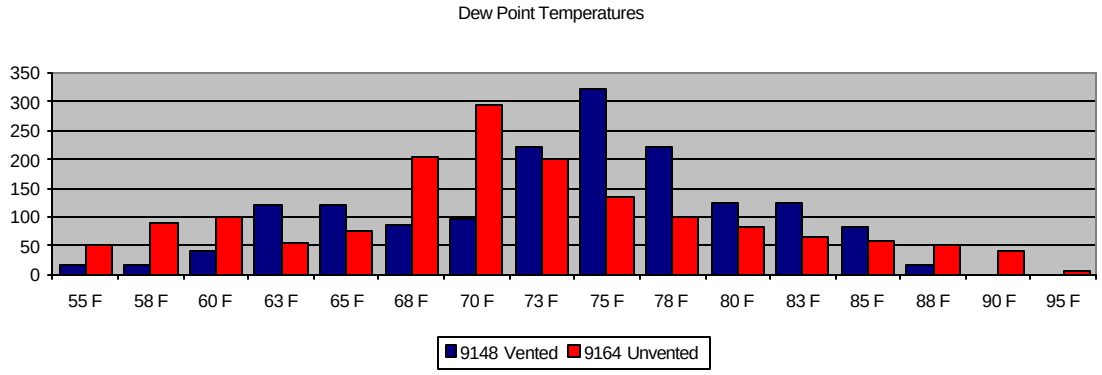

The following shows the distribution of dew point temperatures in the two attics. The unvented attic shows a consistently lower trend in dew point temperature, but a wider variation (maximum of 91.1° F, vs. 87.1° F for vented).

Dew Point Temperatures	Vented	Unvented	Difference
Mean	72.2	70.0	(2.2)
Maximum	87.1	91.1	4.1
Minimum	52.5	50.1	(2.4)
Standard Deviation	7.0	8.6	1.5

ENERGY IMPACTS OF ROOF VENTILATION

This study did not measure energy consumption directly; however at the conclusion of data collection, utility bills will be interpreted to note any major difference in overall energy use.

The unvented attic will likely give lower energy consumption due to lower air change for house. Attic ventilation allows wind pressures to operate on the leaky ceiling plane, therefore increasing infiltration or exfiltration. There is a minimal thermal penalty for not venting: the sensible load in the unvented house is higher, but it appears to be offset by latent load being lower.

A simple model was used to estimate the difference in sensible load through conduction through the ceiling in these two houses. Hourly average insulation top temperatures were subtracted from a fixed setpoint (75° F); the hourly Btu conduction was computed using the temperature difference, the roof insulation value (R-30), and the ceiling area. The difference over the three months of data collected was approximately 15%. However, this is a simplified calculation that only covers conduction, without thermal storage factors. In addition, the ceiling contribution to the total cooling load is approximately 5-7%, resulting in a whole-house load increase of only 1-2%. Finally, this calculation does not take into account the above-mentioned factors of air change effects of venting, as well as latent load effects.

The relative magnitudes of the combined effects might best be seen by using the measured temperature and moisture data with a computer model to estimate overall energy consumption.

CONCLUSIONS

After monitoring temperatures and moisture conditions in the two test houses over three months (September through October), several conclusions could be drawn about the effect of venting on thermal and moisture performance. The temperatures of roof components (tile, sheathing, and insulation) were slightly elevated in the unvented house, but the effect on building durability appears to be minimal.

Attic air temperature was increased (maximum peak difference of 10° F) in the unvented house; however, the overall energy effect of this change is minimal. The elimination of attic venting reduces latent load, as well as infiltration and exfiltration due to wind pressures acting on the leaky ceiling plane. Therefore, overall energy performance may be improved by eliminating attic ventilation.

The unvented roof showed superior moisture performance, as humid outdoor air was no longer being introduced through vents. The attics showed the sorption-desorption behavior noted by Ford (1982).

Overall, more study is recommended. Data will be collected again at the end of the winter, and at the end of the following summer.

DATALOGGING EQUIPMENT SUMMARY

The following equipment was installed in each house.

Attic:

Omega HX-93 (RTD Temperature & RH)
Onset Computer HOBO (Temperature & RH)
Type T Thermocouples: attic air, tile temperature, sheathing temperature, insulation top temperature.

Return:

Omega HX-93 (RTD Temperature & RH)
Onset Computer HOBO (Temperature & RH)

Data collection:

Campbell CR10X Datalogger

Outdoor conditions were recorded by the following equipment:

Onset Computer HOBO Pro (Temperature & RH)

REFERENCES

Burch, D.M., and S.J. Treado. 1979. Ventilation residences and their attics for energy conservation—An experimental study. *Summer Attic and Whole-House Ventilation*, Mary H. Reppert, ed. Washington, DC: National Bureau of Standards.

Ford, J.K. 1982. Humidity measurement and modeling in a residential attic. In *Moisture Migration in Buildings*, ASTM STP 779, M. Lieff and H.R. Trechsel, eds. Pp. 160-190. Philadelphia, PA: American Society for Testing and Materials.

Rose, W.B. 1995. The History of Attic Ventilation Regulation and Research. In *ASHRAE/DOE Thermal Performance of the Exterior envelope of Buildings Conference VI*, Clearwater Beach, FL, December 4-8, 1995.

Rudd, A.F., and J.W. Lstiburek. 1997. Vented and Sealed Attics In Hot Climates. ASHRAE Transactions TO-98-20-3.

TenWolde, A., and W.B. Rose. 1999. Issues Related to Venting of Attics and Cathedral Ceilings. *ASHRAE Transactions 1999*, V. 105, Pt. 1. Atlanta, GA: American Society of Heating, Refrigerating, and Air-conditioning Engineers, Inc.

About this Report

This report was prepared with the cooperation of the U.S. Department of Energy's, Building America Program.

About the Author

Kohta Ueno is a Building Science Corporation Associate. For more information, go to www.buildingscienceconsulting.com.

Direct all correspondence to: Building Science Corporation, 30 Forest Street, Somerville, MA 02143.

Limits of Liability and Disclaimer of Warranty:

Building Science documents are intended for professionals. The author and the publisher of this article have used their best efforts to provide accurate and authoritative information in regard to the subject matter covered. The author and publisher make no warranty of any kind, expressed or implied, with regard to the information contained in this article.

The information presented in this article must be used with care by professionals who understand the implications of what they are doing. If professional advice or other expert assistance is required, the services of a competent professional shall be sought. The author and publisher shall not be liable in the event of incidental or consequential damages in connection with, or arising from, the use of the information contained within this Building Science document.